


METER BOX AND SERVICE PIPE SIZE TABLE

METER SIZE	NON-TRAFFIC AREAS		TRAFFIC AREAS *		WATER SERVICE PIPE SIZE
	CHRISTY BOX	CHRISTY COVER	CHRISTY BOX	CHRISTY COVER	
5/8", 3/4"	B-12	N12T	B1017 H/20	B1017 61GH WITH 5"X8" READING LID	1"
1"	B-16	N16T	B1324 H/20	B1324 61GH WITH 5"X8" READING LID	1"
1 1/2" & 2"	B-36	N36T	B1730 H/20	B1730-51G WITH 8"X12" READING LID	2"

* Install 6" P.C.C. slab underneath for support.

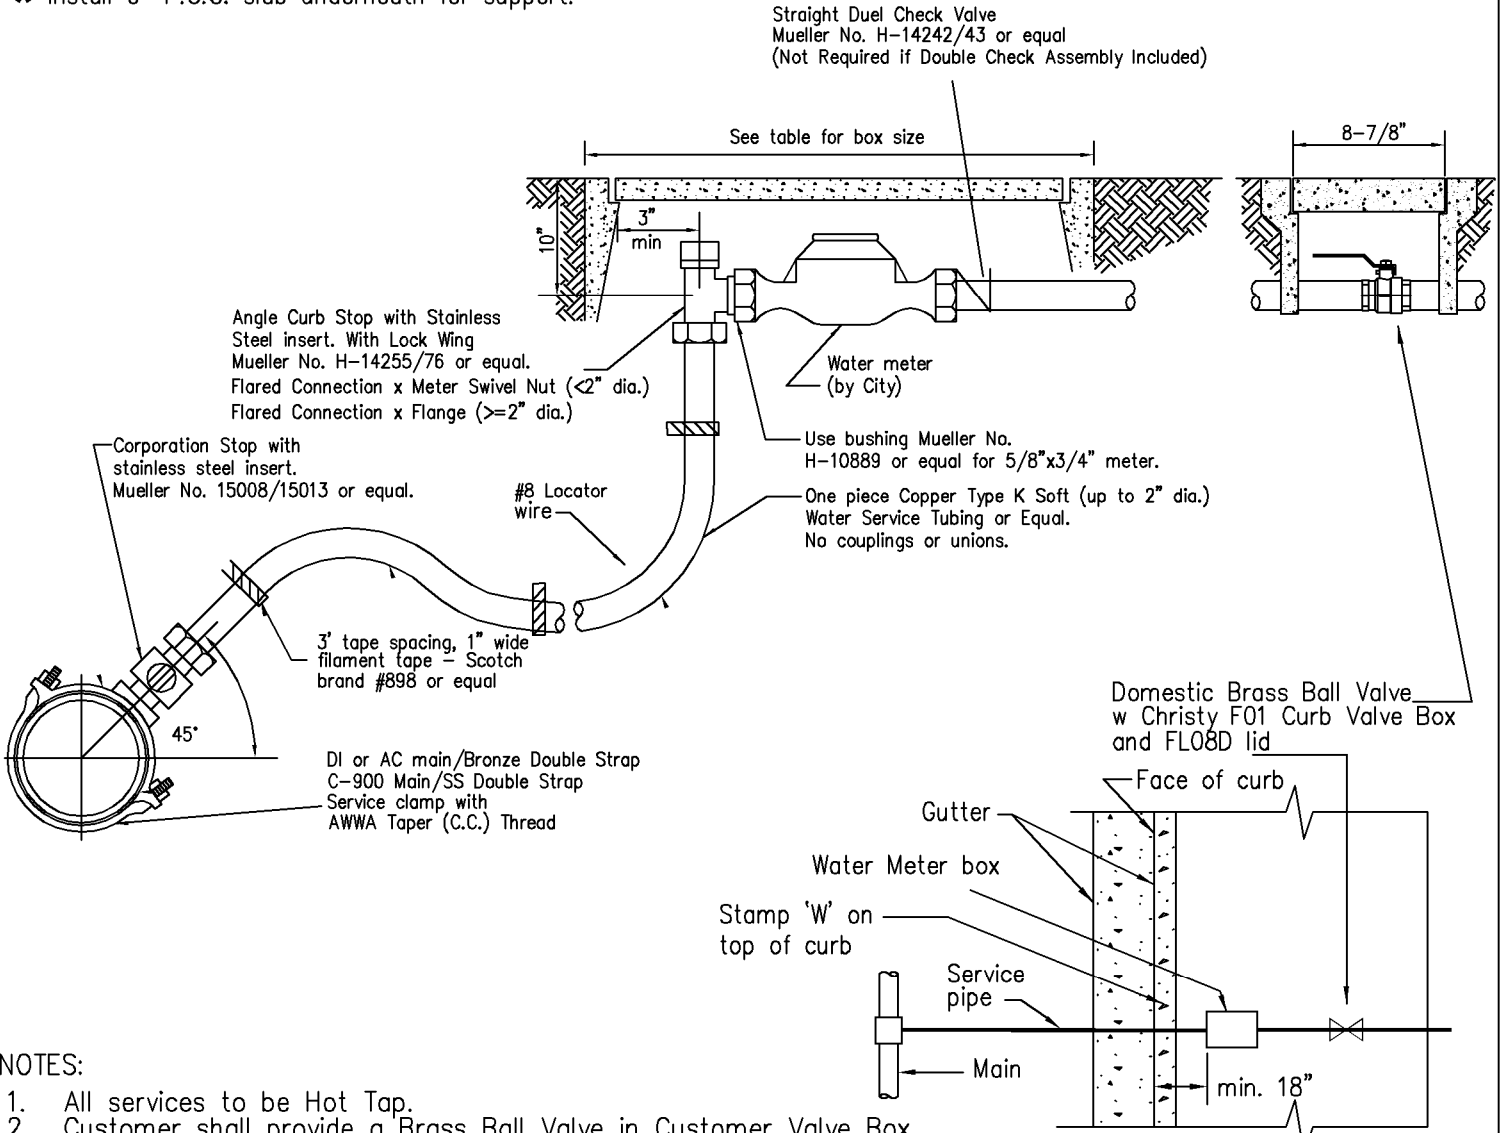

NOTES:

1. All services to be Hot Tap.
2. Customer shall provide a Brass Ball Valve in Customer Valve Box immediately downstream of the meter box.
3. Mark a "W" on curb at all water services.
4. Center Meter Box over Meter to grade.
5. Install touch reading lids for this project.
6. Minimum bronze swing check valve required after meter.
7. Double check assembly is required for common domestic and fire suppression system lines (See W-4A)

NOT TO SCALE

LOCATION PLAN HOUSE SERVICE

STANDARD DETAIL	CITY OF BRISBANE DEPARTMENT OF PUBLIC WORKS	
	2" DIAMETER and UNDER SERVICE CONNECTION	W - 3

DATE: 10/05/15